




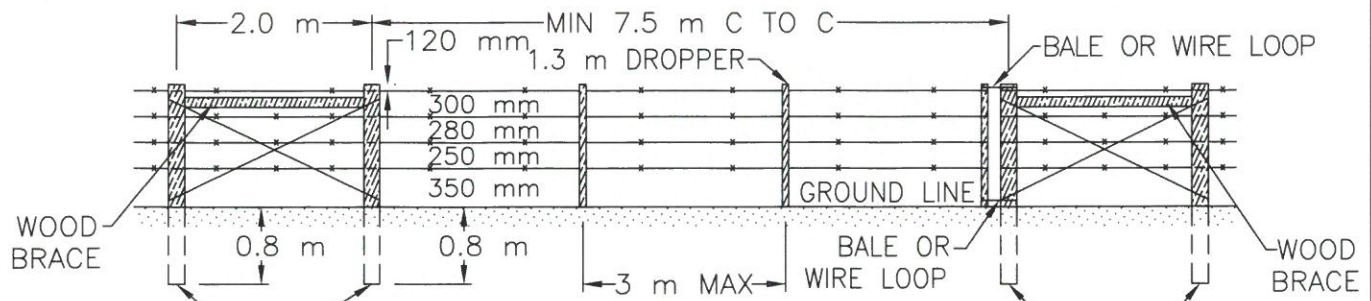


DETAIL OF GATE

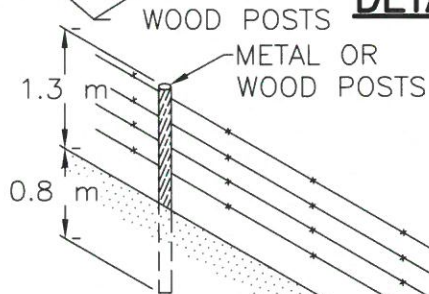

PERSPECTIVE OF FENCE CORNER

DETAILS FOR BRACING

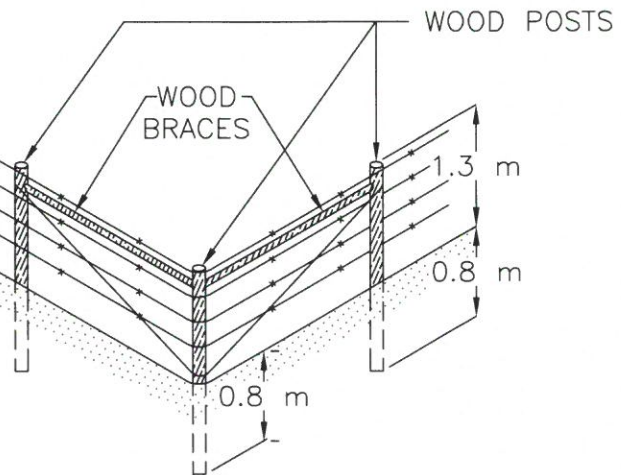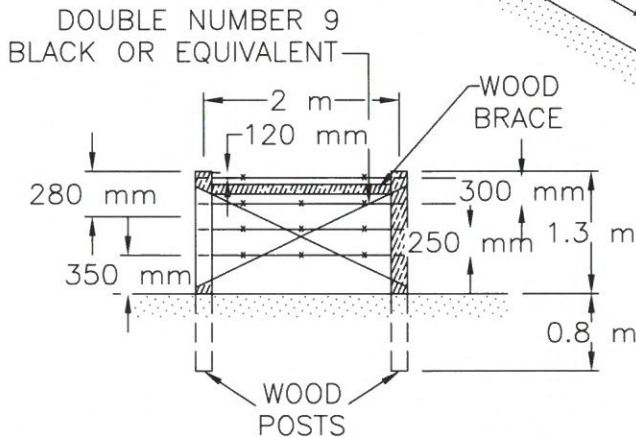

NOTES:

1. Fence posts shall be erected 5 m, centre to centre, except where bracing is required.
2. All corners shall be braced in each direction in accordance with the details for bracing.
3. Each gate post shall be braced in accordance with details for bracing.
4. The fence shall be braced at intervals not greater than 300 m between gates and corners.
5. Metal posts may be channel or T-Type posts.
6. Wood posts may be used for wood braces.
7. Droppers will be approximately 50 mm dia. or 38 mm x 76 mm material. Wood posts may be sawn lengthwise to form droppers.
8. Wire shall be placed on the side of the fence facing the adjoining private property (except on a curve, the wire shall be placed so that it is pulling against the posts, not the staples) unless the owner of the private property requests otherwise.
9. The wire spacing may be varied at the request of the property owner, provided that the spacing requested conforms to the Stray Animal Act.
10. Wood posts will be sharpened, treated, and have dimensions not less than 100 mm x 2.1 m.
11. Staples shall be 3.5 mm minimum in diameter and 45 mm minimum in length. They shall be barbed and galvanized.
12. Barbed wire shall be 12.5 gauge minimum, soft galvanized, double strand, with four point 2.0 mm thick round barbs, spacing no more than 150 mm.



**STANDARD BARBED WIRE FENCE
4 WIRE**

RECOMMENDED BY		DIRECTOR DESIGN & TRAFFIC ENG	DATE	Mar 2/16	STANDARD PLAN NO	26510
APPROVED BY		EXECUTIVE DIRECTOR TECHNICAL STANDARDS BRANCH	DATE	Mar 2/16	SHEET	1 OF 1

ACAD DWG: SKS26510
LAST REV DATE: 16/01/29