


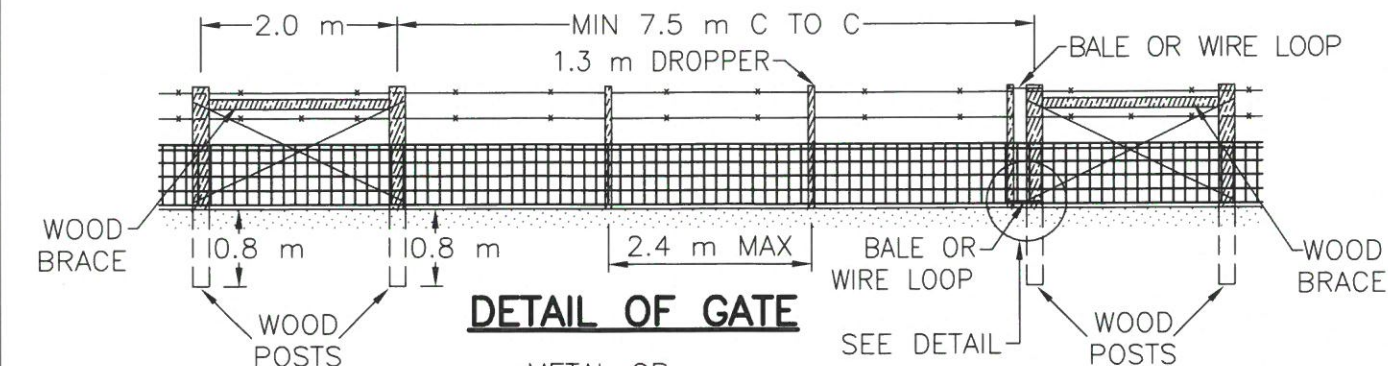
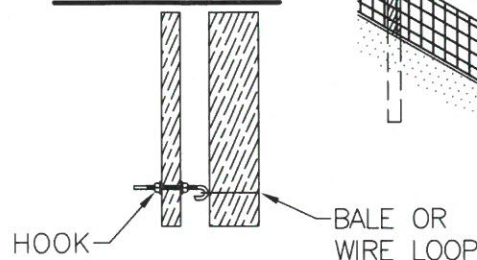


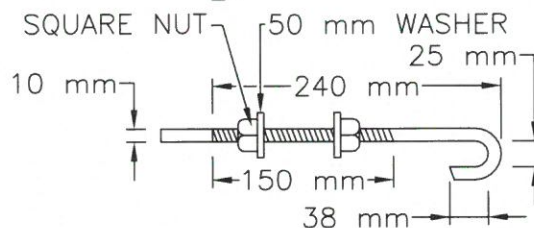

DETAIL OF HOOK AND BALE OR WIRE LOOP

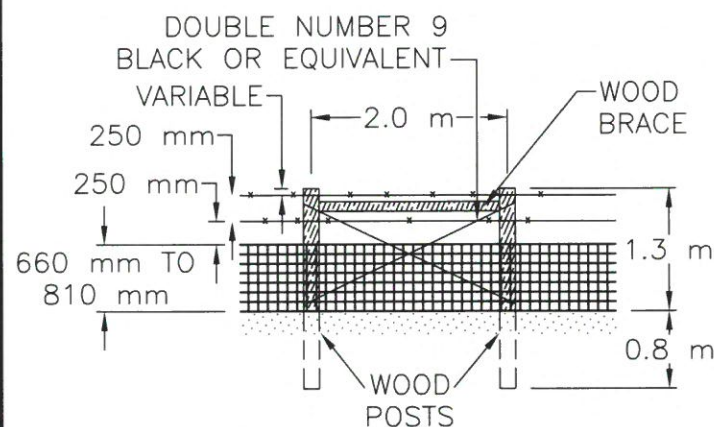

PERSPECTIVE OF FENCE CORNER

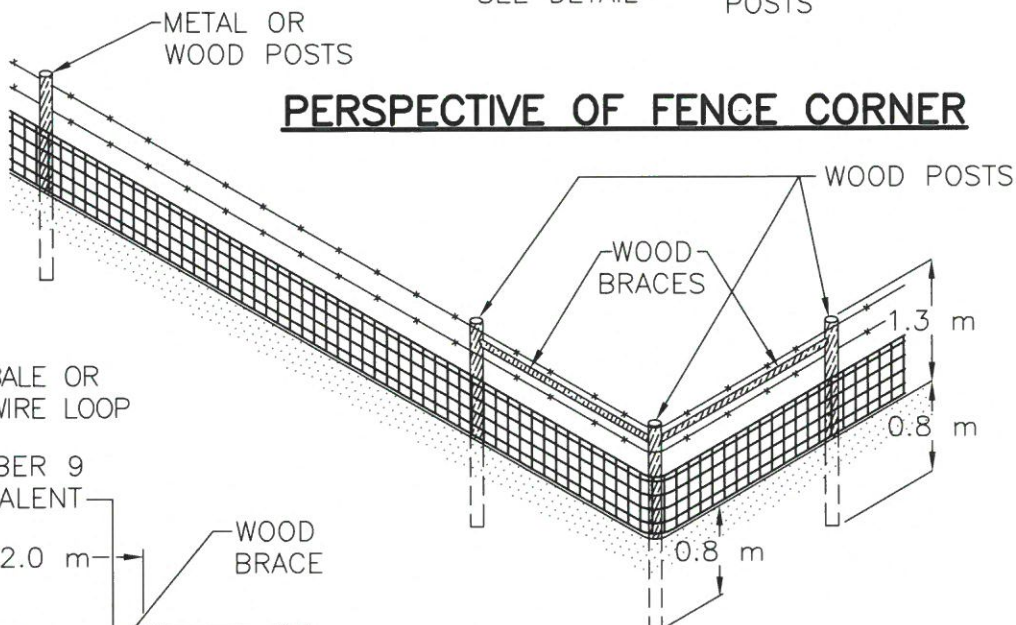

NOTES:

1. Fence posts shall be erected 5 m, centre to centre, except where bracing is required.
2. All corners shall be braced in each direction in accordance with the details for bracing.
3. Each gate post shall be braced in accordance with details for bracing.
4. The fence shall be braced at intervals not greater than 300 m between gates and corners.
5. Wood posts may be used for wood braces.
6. Droppers will be approx. 50 mm dia. or 38 mm x 76 mm material. Wood posts may be sawn lengthwise to form droppers.
7. Wire shall be placed on the side of the fence posts facing the adjoining private property (except on a curve, the wire shall be placed so that it is pulling against the posts, not the staples) unless the owner of the private property requests otherwise.
8. Metal posts may be channel or T-type.
9. Wood posts will be sharpened and treated and have dimensions not less than 100 mm x 2.1 m.
10. Staples shall be 3.5 mm minimum in diameter and 45 mm minimum in length. They shall be barbed and galvanized.
11. Barbed wire shall be 12.5 gauge minimum, soft galvanized, double-strand, with four-point 2.0 mm thick round barbs, spacing no more than 150 mm.
12. Welded wire shall be 12.5 gauge, class 1 or better zinc coated, non-climbable, welded lawn fence (field fence) with a 50 mm x 100 mm grid. Minimum roll width shall be 914.4 mm.



STANDARD WELDED WIRE FENCE TYPE A

RECOMMENDED BY		DIRECTOR DESIGN & TRAFFIC ENG	DATE	Mar 2/16	STANDARD PLAN NO	26520
APPROVED BY		EXECUTIVE DIRECTOR TECHNICAL STANDARDS BRANCH	DATE	Mar 2/16	SHEET	1 OF 1